




LASER ENGRAVED BLACK
CUSTOMER TO CONFIRM
REQUIRED WORDING

ALARM REMOTE DISPLAY PANEL

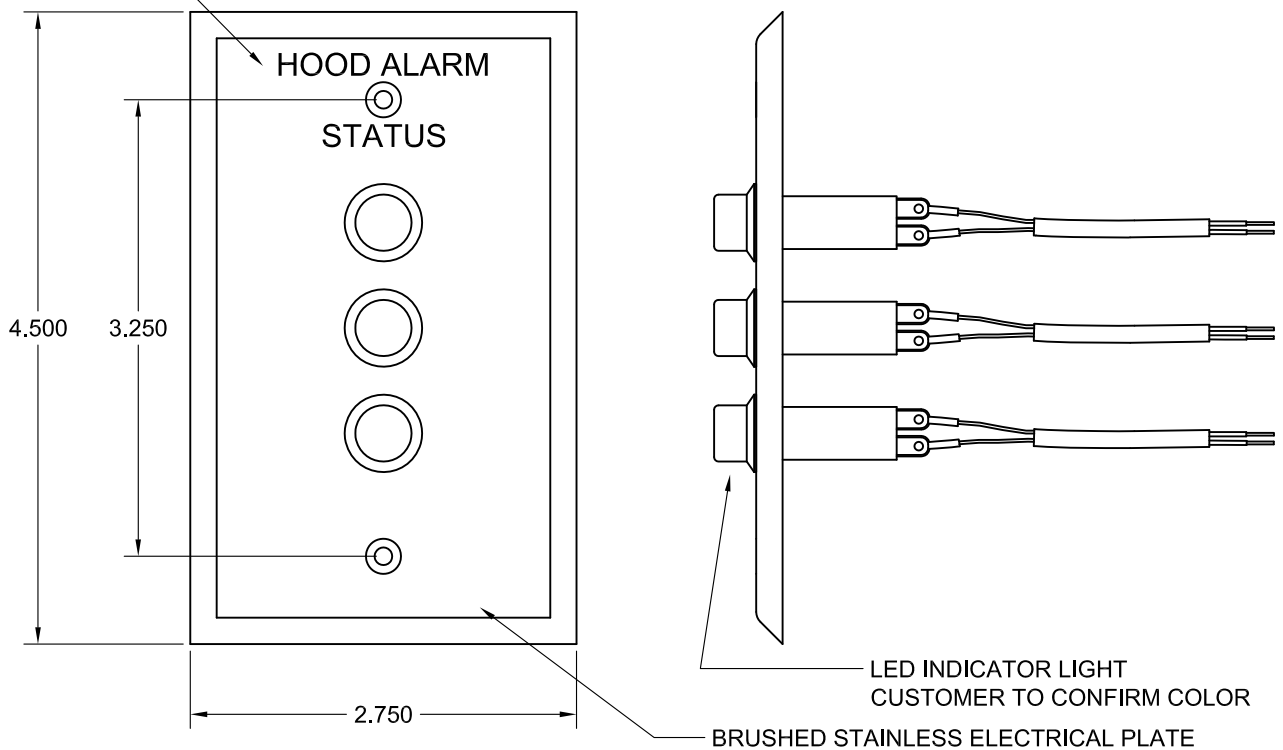

NOTE: SHALL BE USED FOR LESS THAN 30V OPERATION.
THIS MUST BE INSTALLED IN ACCORDANCE WITH THE NEC
GUIDELINES FOR CLASS 2 WIRING

UP TO THREE UNITS MAY BE CONNECTED TO ALARM RELAY OUTPUT USING POWER SUPPLY OF ALARM

SHIPS WITH COMPLETE WIRING INSTRUCTIONS, SPLICE CONNECTORS AND 100 FEET
OF CATEGORY 2 WIRE

HOLLAND SAFETY EQUIPMENT	
HSE	REMOTE DISPLAY PANEL
MODEL: DP-001	
NO:	REV: 1
DATE: 30 MAY 2012	BY:

MATERIAL: BRUSHED STAINLESS STEEL